


NOTES:

INSTALL FULL SIZE (MINIMUM SIZE) VENT TO ATMOSPHERE.

INSTALL FULL SIZE (MINIMUM SIZE) OVERFLOW TO AIR-GAP OR OPEN DRAIN.

VENT PIPING DETAIL MUST BE DESIGNED AND INSTALLED BY A PROFESSIONAL LICENSED & REGISTERED AS REQUIRED FAMILIAR WITH EQUIPMENT AND ITS INTENDED USE TO MEET ALL LOCAL, STATE AND FEDERAL CODES RULES AND REGULATIONS.

GV - GATE VALVE
CV - CHECK VALVE
SC - STEAM OR PLUG COCK
AG - AIR GAP

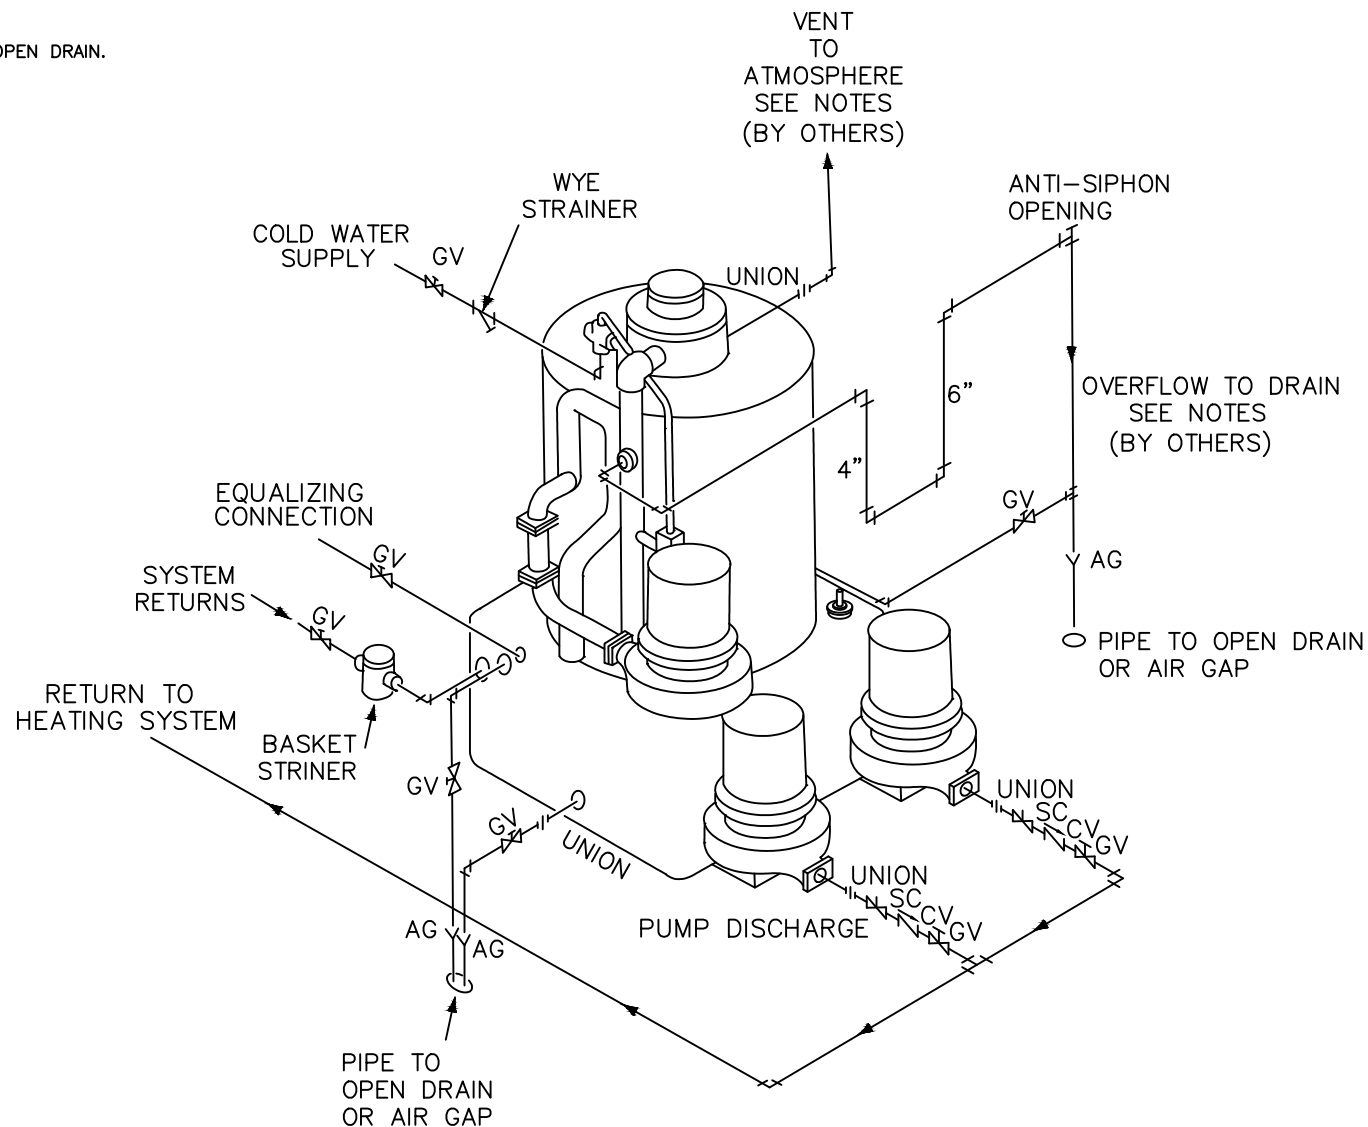

SHIPCO®
PUMPS

MANUFACTURED BY

SHIPPENSBURG PUMP COMPANY INC.

P.O. Box 279 Shippensburg, Pa. 17257

PHONE 717 532-7321 / FAX 717 532-7704

WWW.SHIPCO PUMPS.COM

SHIPCO® IS A REGISTERED TRADEMARK OF SHIPPENSBURG PUMP CO., INC.

Typical Piping Diagram Type BVC - Vacuum Condensate

DRAWN BY	DATE	REVISION
J.S.	12/20	.5
PIPING DIAGRAM		
30003		
Section BVC Page 2900		