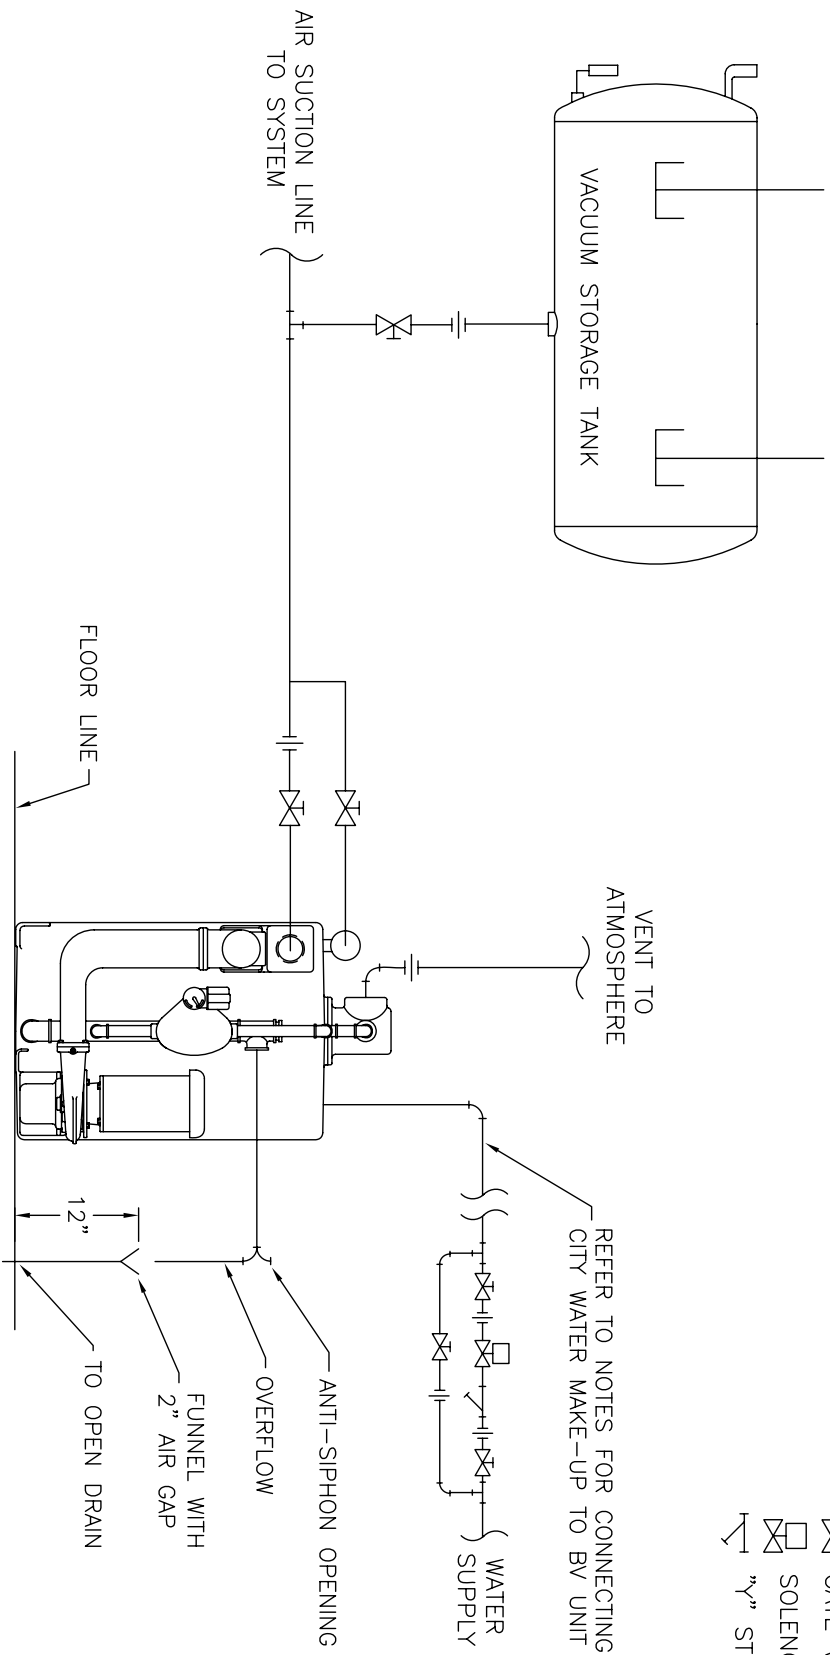


NOTES:

- INSTALL FULL SIZE (MINIMUM SIZE) VENT TO ATMOSPHERE.
- INSTALL FULL SIZE (MINIMUM SIZE) OVERFLOW TO AIR-GAP OR OPEN DRAIN.
- VENT PIPING DETAIL MUST BE DESIGNED AND INSTALLED BY A PROFESSIONAL LICENSED & REGISTERED AS REQUIRED FAMILIAR WITH EQUIPMENT AND ITS INTENDED USE TO MEET ALL LOCAL, STATE AND FEDERAL CODES RULES AND REGULATIONS.
- MUNICIPAL CODES MUST BE FOLLOWED: LOCAL, STATE AND FEDERAL PLUMBING CODES NORMALLY REQUIRE ANTI-SIPHON PROVISIONS – AIR GAPS, BACK-FLOW PREVENTERS, AND/OR VACUUM BREAKERS ARE COMMON REQUIREMENTS.
- CONSULT THE JURISDICTIONAL CODE OFFICER WHERE YOU ARE INSTALLING FOR CODE REQUIREMENTS.

SHIPCO®
SPUMPS

MANUFACTURED BY

SHIPPENSBURG PUMP COMPANY INC.
P.O. Box 279 Shippenburg, Pa. 17257
PHONE 717 532-7321 / FAX 717 532-7704

WWW.SHIPCOPLUMPS.COM

SHIPCO® IS A REGISTERED TRADEMARK OF SHIPPENSBURG PUMP CO., INC.

Typical Piping Diagram
Type BV - Vacuum Unit
w/ Horizontal Storage Tank

DRAWN BY	DATE	REVISION
C. REED	10/04	.4
DIMENSION POINT	30005	