


- LEGEND**
- |—|— UNION
 - ⊞ GATE VALVE
 - ⊞ SOLENOID VALVE
 - ⊞ "Y" STRAINER

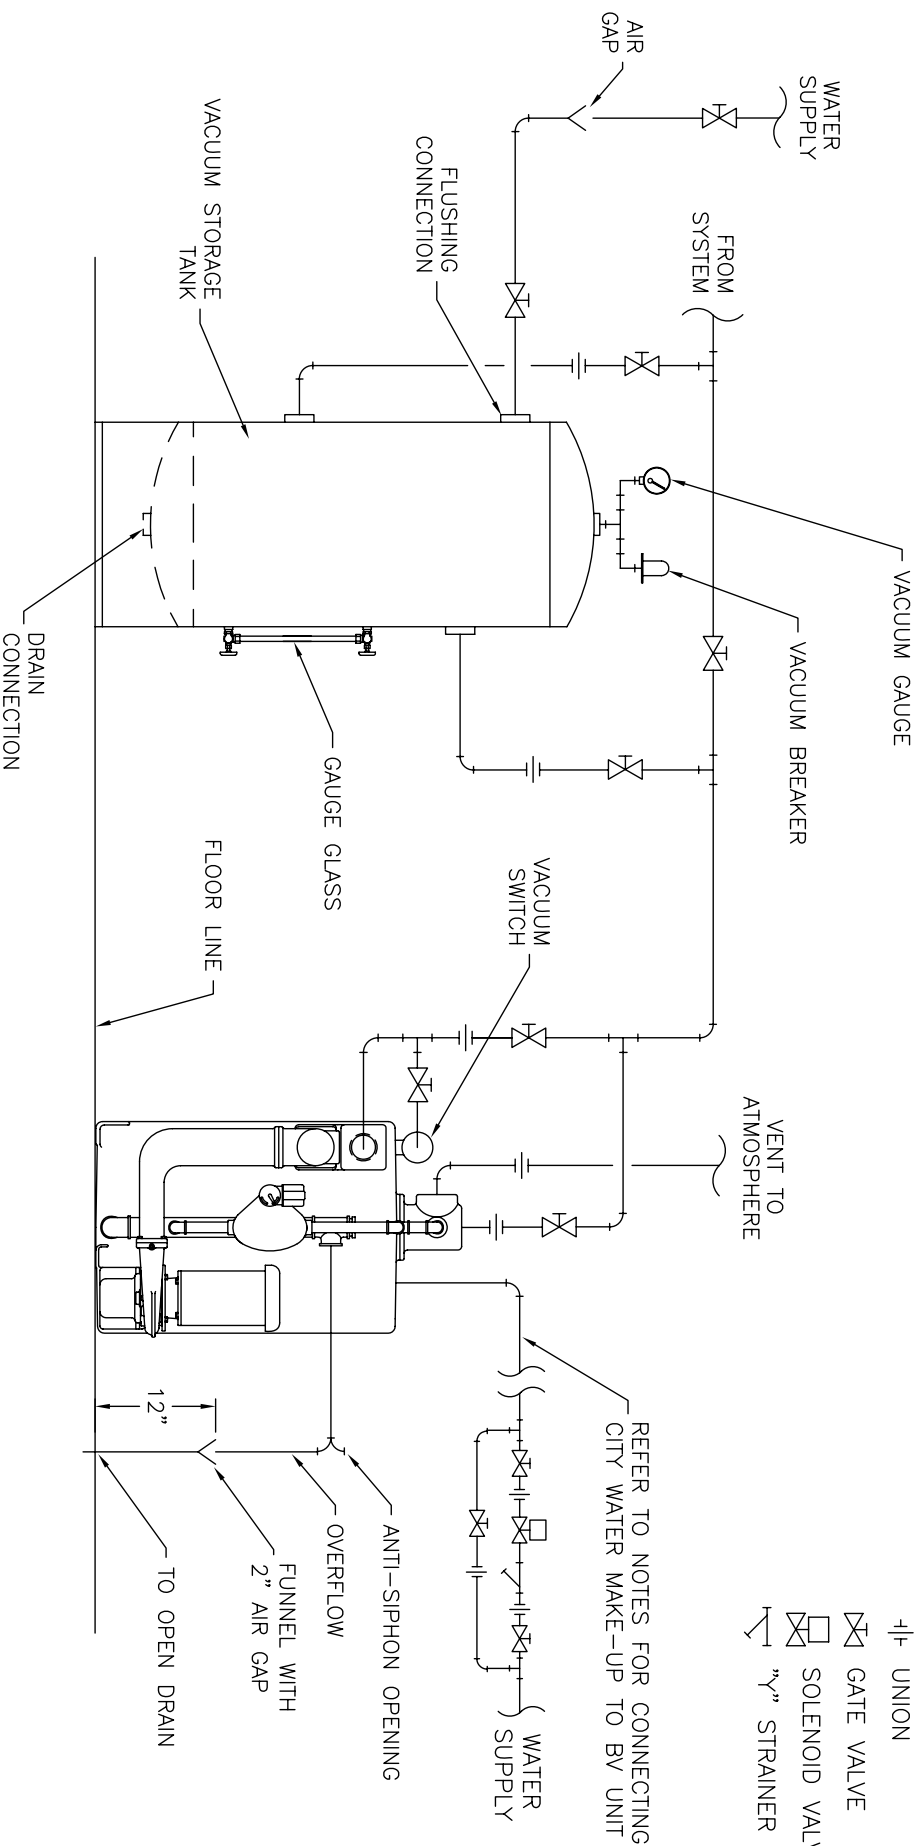

NOTES:

INSTALL FULL SIZE (MINIMUM SIZE) VENT TO ATMOSPHERE.
INSTALL FULL SIZE (MINIMUM SIZE) OVERFLOW TO AIR-GAP OR OPEN DRAIN.

VENT PIPING DETAIL MUST BE DESIGNED AND INSTALLED BY A
PROFESSIONAL LICENSED & REGISTERED AS REQUIRED
FAMILIAR WITH EQUIPMENT AND ITS INTENDED USE TO MEET ALL
LOCAL, STATE AND FEDERAL CODES RULES AND REGULATIONS.

MUNICIPAL CODES MUST BE FOLLOWED: LOCAL, STATE AND FEDERAL PLUMBING
CODES NORMALLY REQUIRE ANTI-SIPHON PROVISIONS – AIR GAPS, BACK-FLOW PREVENTERS,
AND/OR VACUUM BREAKERS ARE COMMON REQUIREMENTS.

CONSULT THE JURISDICTIONAL CODE OFFICER WHERE YOU ARE INSTALLING FOR CODE REQUIREMENTS.

**SHIPCO®
PUMPS**

MANUFACTURED BY

SHIPPENSBURG PUMP COMPANY INC.
P.O. Box 279 Shippenburg, Pa. 17257
PHONE 717 532-7321 / FAX 717 532-7704
WWW.SHIPCO.PUMPS.COM

SHIPCO® IS A REGISTERED TRADEMARK OF SHIPPENSBURG PUMP CO., INC.

Typical Piping Diagram
Type BV - Vacuum Unit
w/ Vertical Storage Tank

DRAWN BY	DATE	REVISION
C. REED	10/04	.4
DIMENSION PRINT		
30006		