




DISCHARGE PIPING W/ AUTOMATIC FLOW VALVE

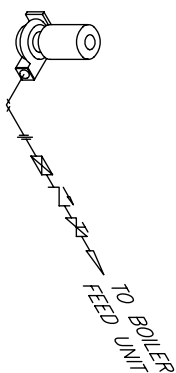

If centrifugal feed pump is operating at 75 PSIG or greater a Automatic Flow Valve typically is utilized.

LEGEND

- AUTOMATIC FLOW CONTROL VALVE
- BALANCING VALVE
- GATE VALVE
- CHECK VALVE
- INLET STRAINER
- UNION
- AIR GAP

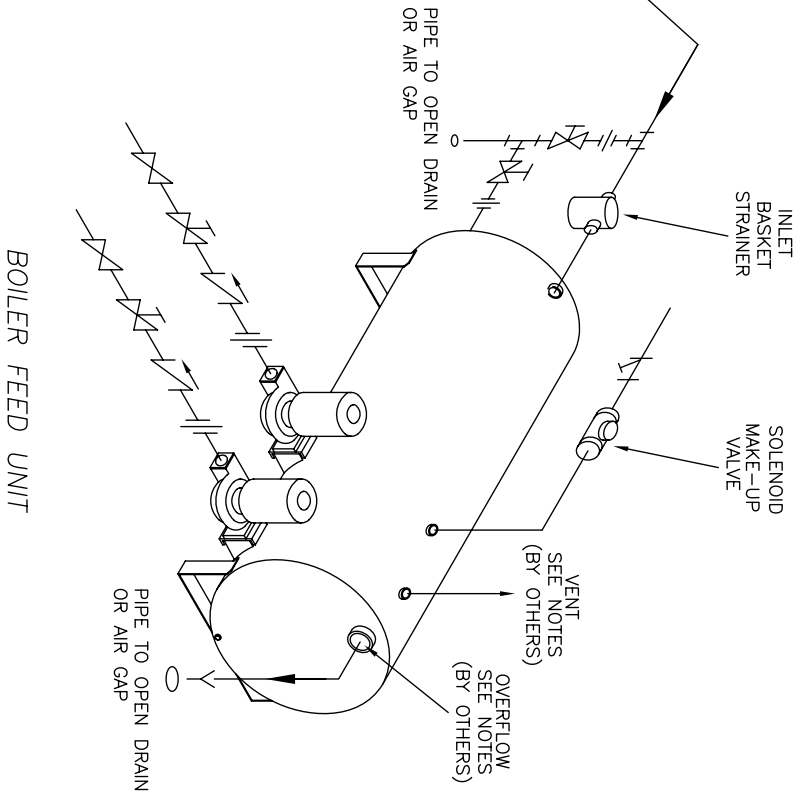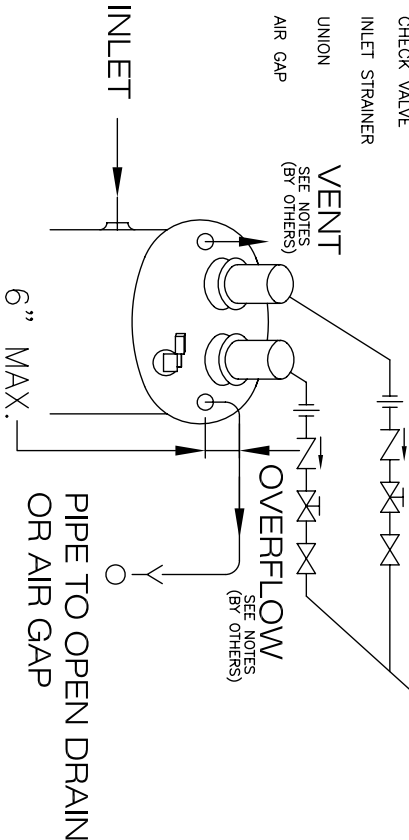

NOTES:

- INSTALL FULL SIZE (MINIMUM SIZE) VENT TO ATMOSPHERE.
- INSTALL FULL SIZE (MINIMUM SIZE) OVERFLOW TO AIR-GAP OR OPEN DRAIN.
- VENT PIPING DETAIL MUST BE DESIGNED AND INSTALLED BY A PROFESSIONAL LICENSED & REGISTERED AS REQUIRED FAMILIAR WITH EQUIPMENT AND ITS INTENDED USE TO MEET ALL LOCAL, STATE AND FEDERAL CODES RULES AND REGULATIONS.

SHIPCO®
PUMPS

MANUFACTURED BY

SHIPPENSBURG PUMP COMPANY INC.
P.O. Box 279 Shippensburg, Pa. 17257
PHONE 717 532-7321 / FAX 717 532-7704
WWW.SHIPCOPIUMPS.COM

Shipco® IS A REGISTERED TRADEMARK OF SHIPPENSBURG PUMP CO., INC.

Typical Piping Diagram
Underground Unit
Centrifugal Pumps

DRAWN BY	DATE	REVISION
M.E.R.	9/07	.2

PIPING DIAGRAM

30014