


# SUGGESTED REGULATOR PIPING

ATMOSPHERIC, VENTURI OR LOW PRESSURE STEAM

T. CONNECT TEMPERATURE SENSING LINE FROM T-T

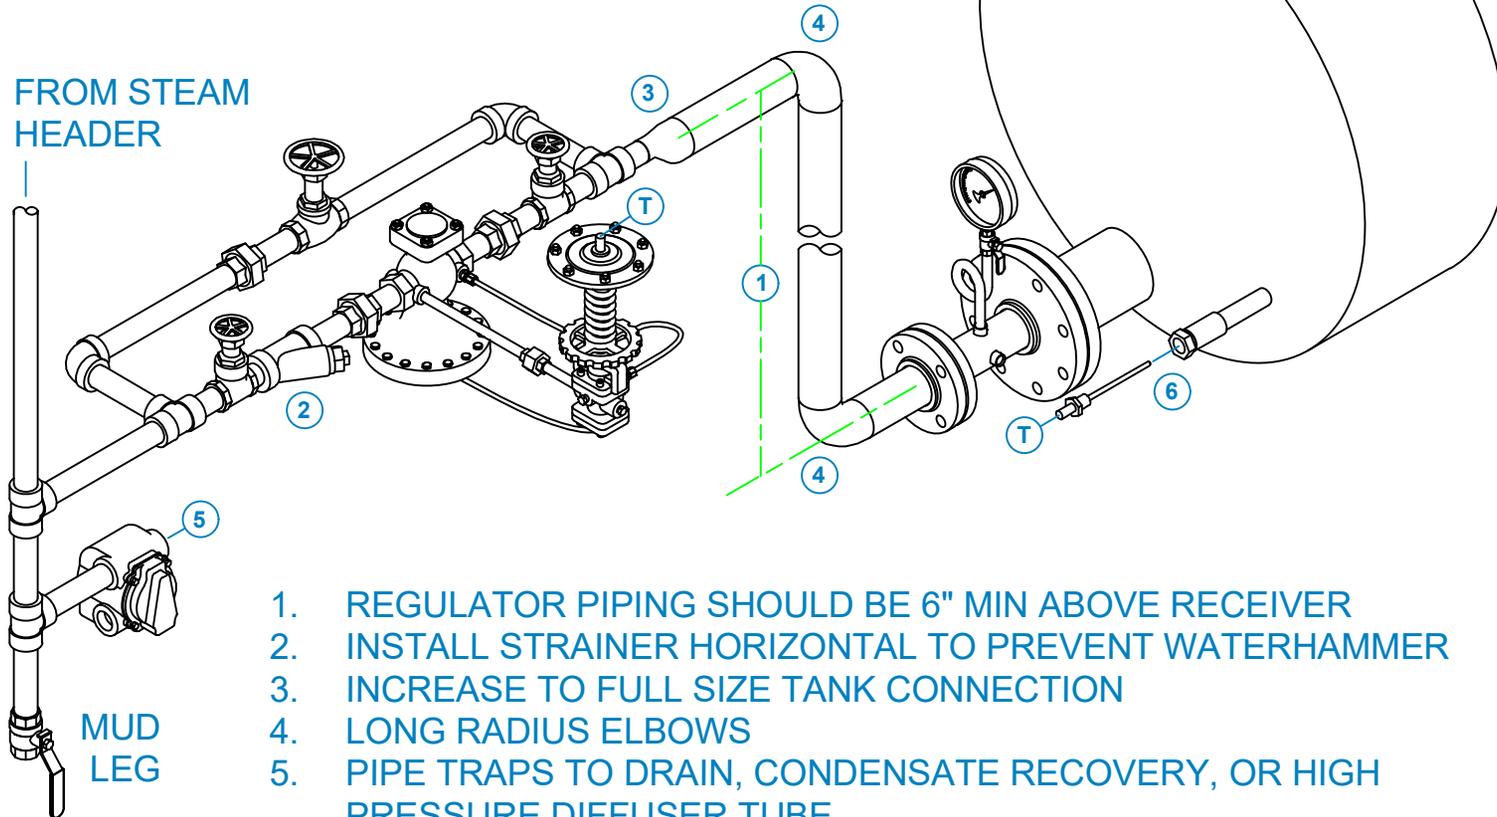

1. REGULATOR PIPING SHOULD BE 6" MIN ABOVE RECEIVER
2. INSTALL STRAINER HORIZONTAL TO PREVENT WATERHAMMER
3. INCREASE TO FULL SIZE TANK CONNECTION
4. LONG RADIUS ELBOWS
5. PIPE TRAPS TO DRAIN, CONDENSATE RECOVERY, OR HIGH PRESSURE DIFFUSER TUBE
6. PACK WELL WITH THERMAL GREASE



**SHIPPENSBURG PUMP CO., INC.**

P.O. Box 279 Shippensburg, PA 17257  
(717) 532-7321 • www.shipcopumps.com

SHIPCO® is a registered trademark of Shippensburg Pump Co., Inc.

## Spence Type E Regulator and Type T14 Temperature Pilot

SECTION	DRAWING NO.	REV.	DATE
	REG-PIPE-ET14		